




COMPLEXE INDUSTRIEL DU LITTORAL - CAMEROUN



MAZZONI LB
SINCE 1946




NUMERO DI SERIE / ANNO <i>SERIAL NUMBER / YEAR</i>	2015
TIPO <i>TYPE</i>	SB-CR 72T/J
COMMESSA <i>JOB ORDER No</i>	R.500676.01
ITEM <i>ITEM</i>	QE-106.02
NUMERO DI SCHEMA ELETTRICO <i>WIRING DIAGRAM NUMBER</i>	SE13174
CONFORME ALLA NORMA <i>IN CONFORMITY WITH STANDARDS</i>	EN 60204-1.CE117
NATURA DELLA CORRENTE / FREQUENZA <i>TYPE OF CURRENT / FREQUENCY</i>	3PH/AC 50HZ
TENSIONE DI IMPIEGO NOMINALI / Nr. FASI <i>NOMINAL WORKING VOLTAGE / No. PHASES</i>	380VAC
TENSIONI DI ISOLAMENTO NOMINALI <i>NOMINAL VOLTAGE INSOLATION</i>	1000V
TENSIONI NOMINALI DEI CIRCUITI AUSILIARI <i>AUXILIARY CIRCUITS NOMINAL VOLTAGE</i>	220VAC 24VDC
CORRENTE NOMINALE / POTENZA NOMINALE <i>NOMINAL CURRENT / NOMINAL POWER</i>	10A
TENUTA AL CORTOCIRCUITO <i>SHORT CIRCUIT RESISTANCE</i>	5KA
GRADO DI PROTEZIONE / MASSA <i>PROTECTION / MASS</i>	IP54

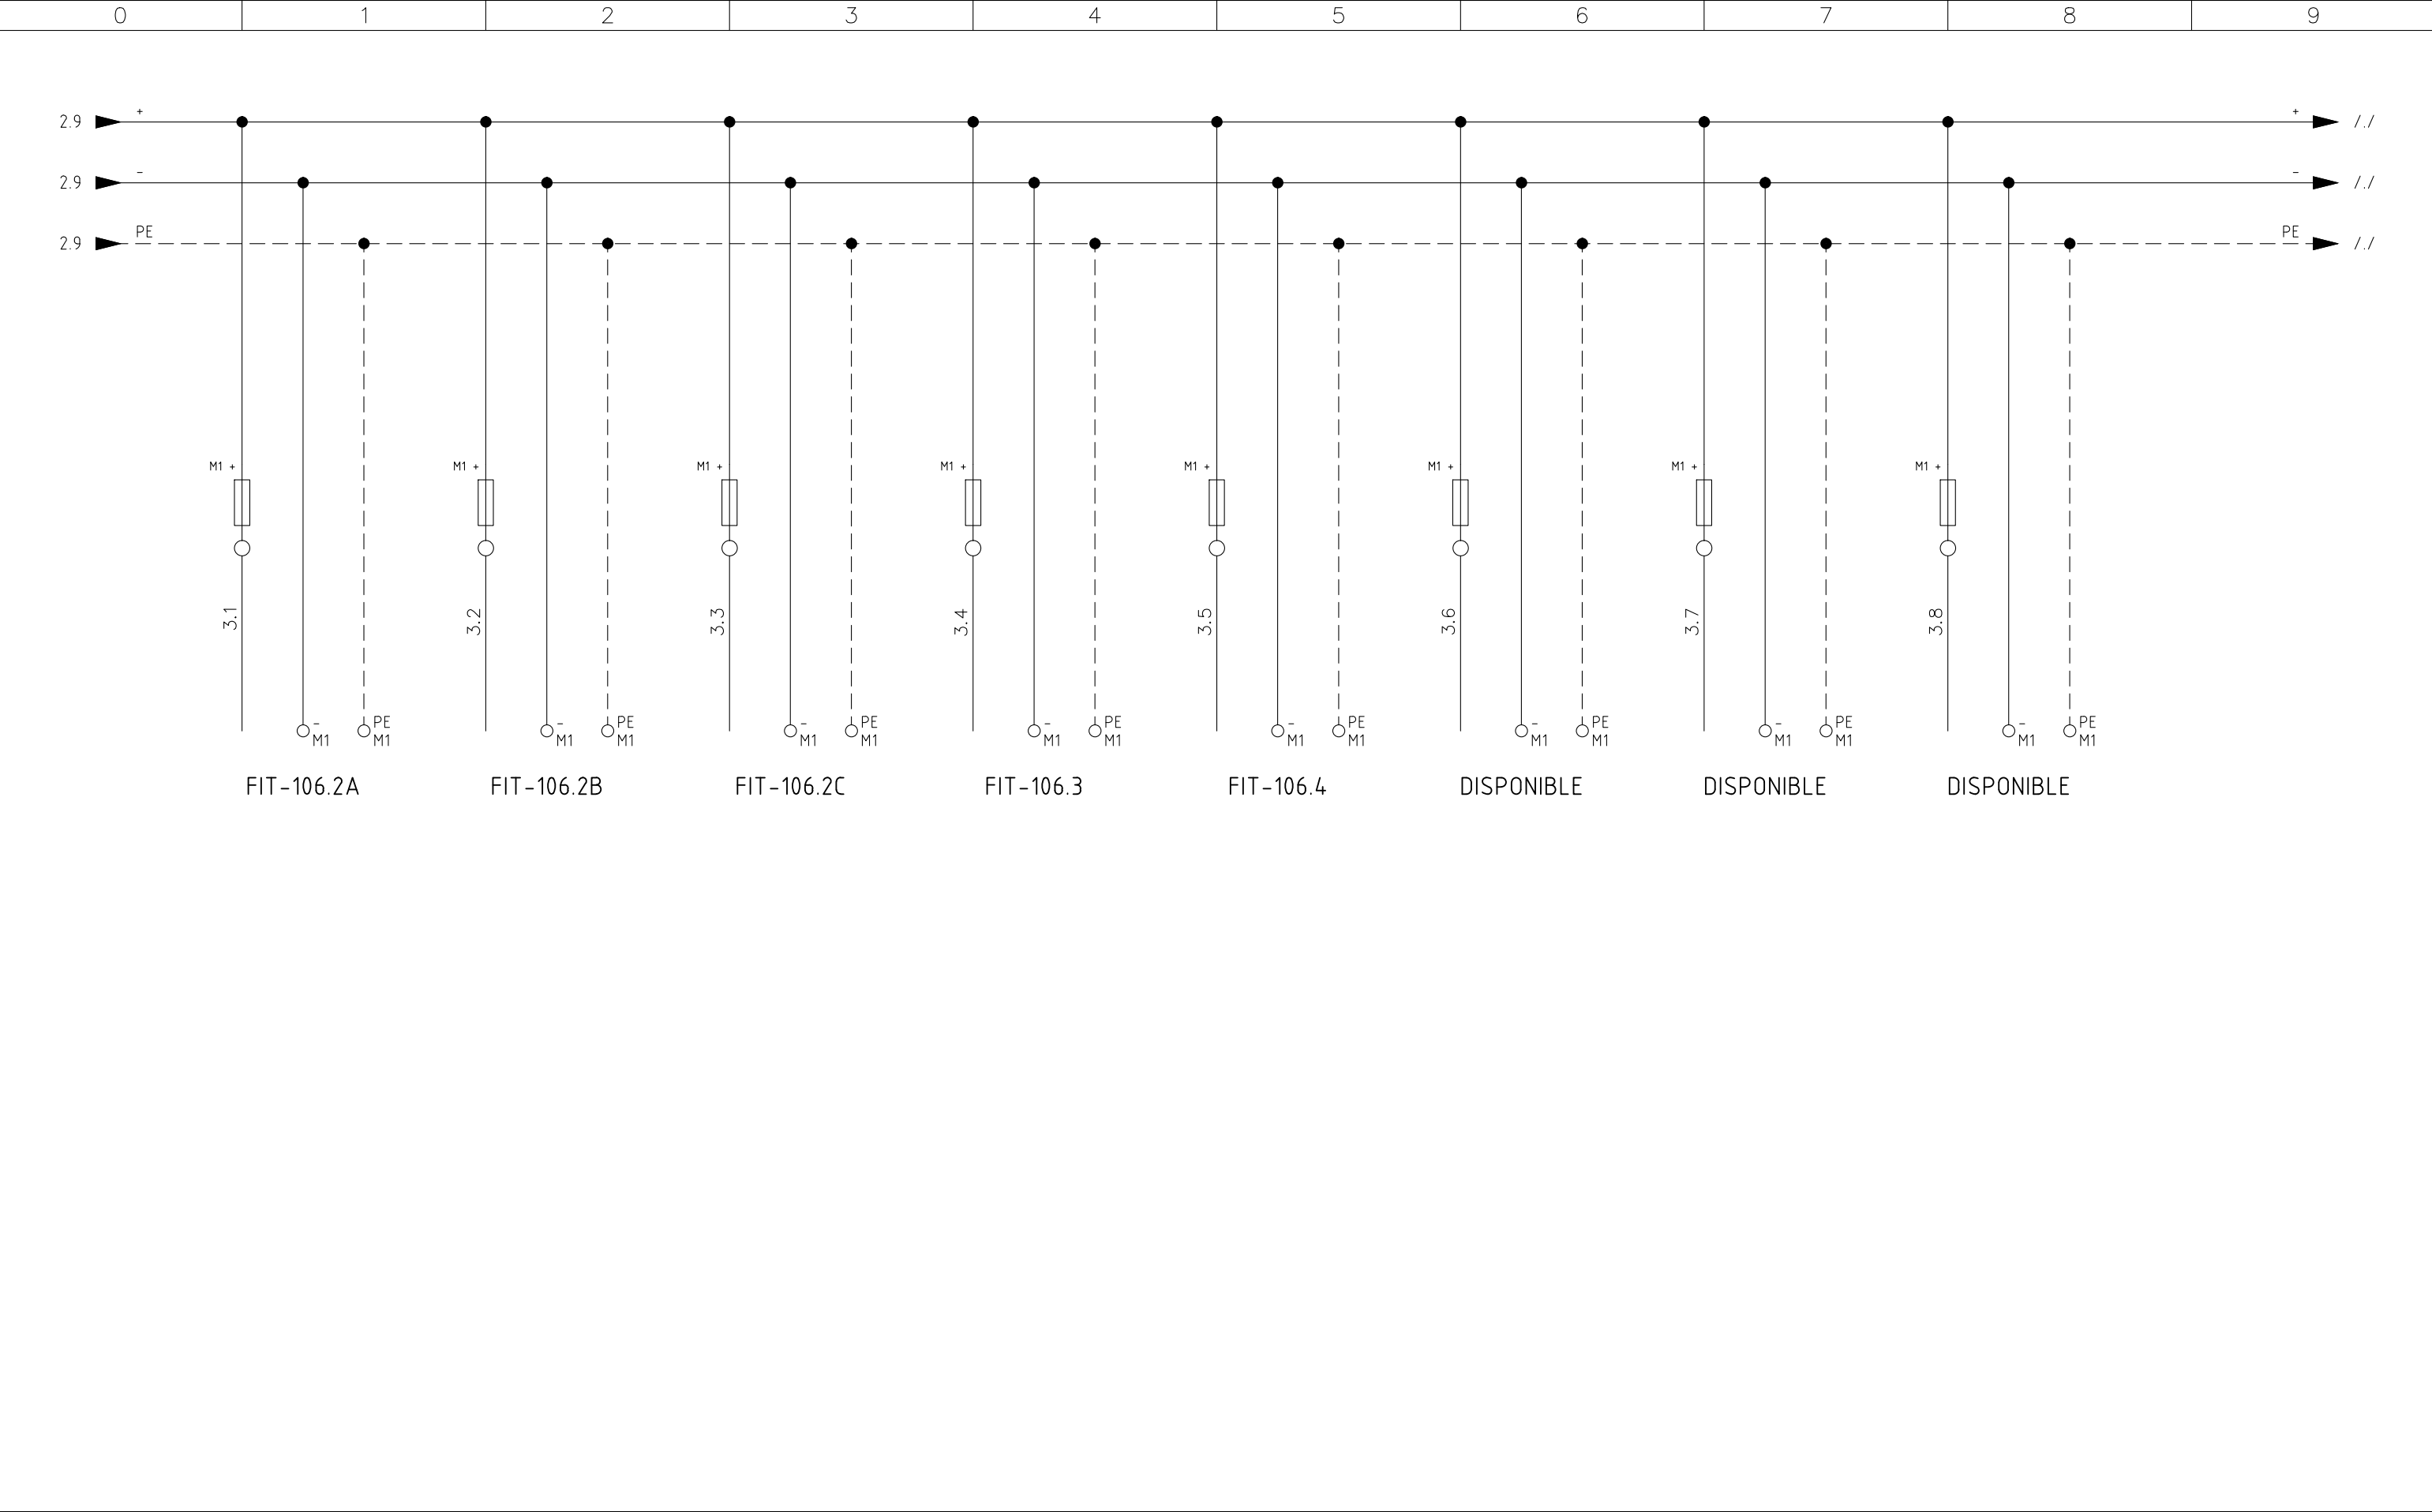



MAZZONI L B S.p.A. BUSTO ARSIZIO – ITALY	Code C.B. : 3028883		Customer : C.I.L. – CAMEROUN		Scale	Job No. : R.500676.01	Sheet 3
	Code E.F. : —		Plant : SB–CR 72T/J – QE–106.02				Next 4
	Cad : SPAC2014		Description : INSTRUMENTS FEEDING LINES		Quantity	Draw No. : SE13174	Total 14
	Date : 21–1–15		Drawn : P.D.	Checked :			
	This drawing is reserved property and cannot be copied or reproduced without our written authorisation.						

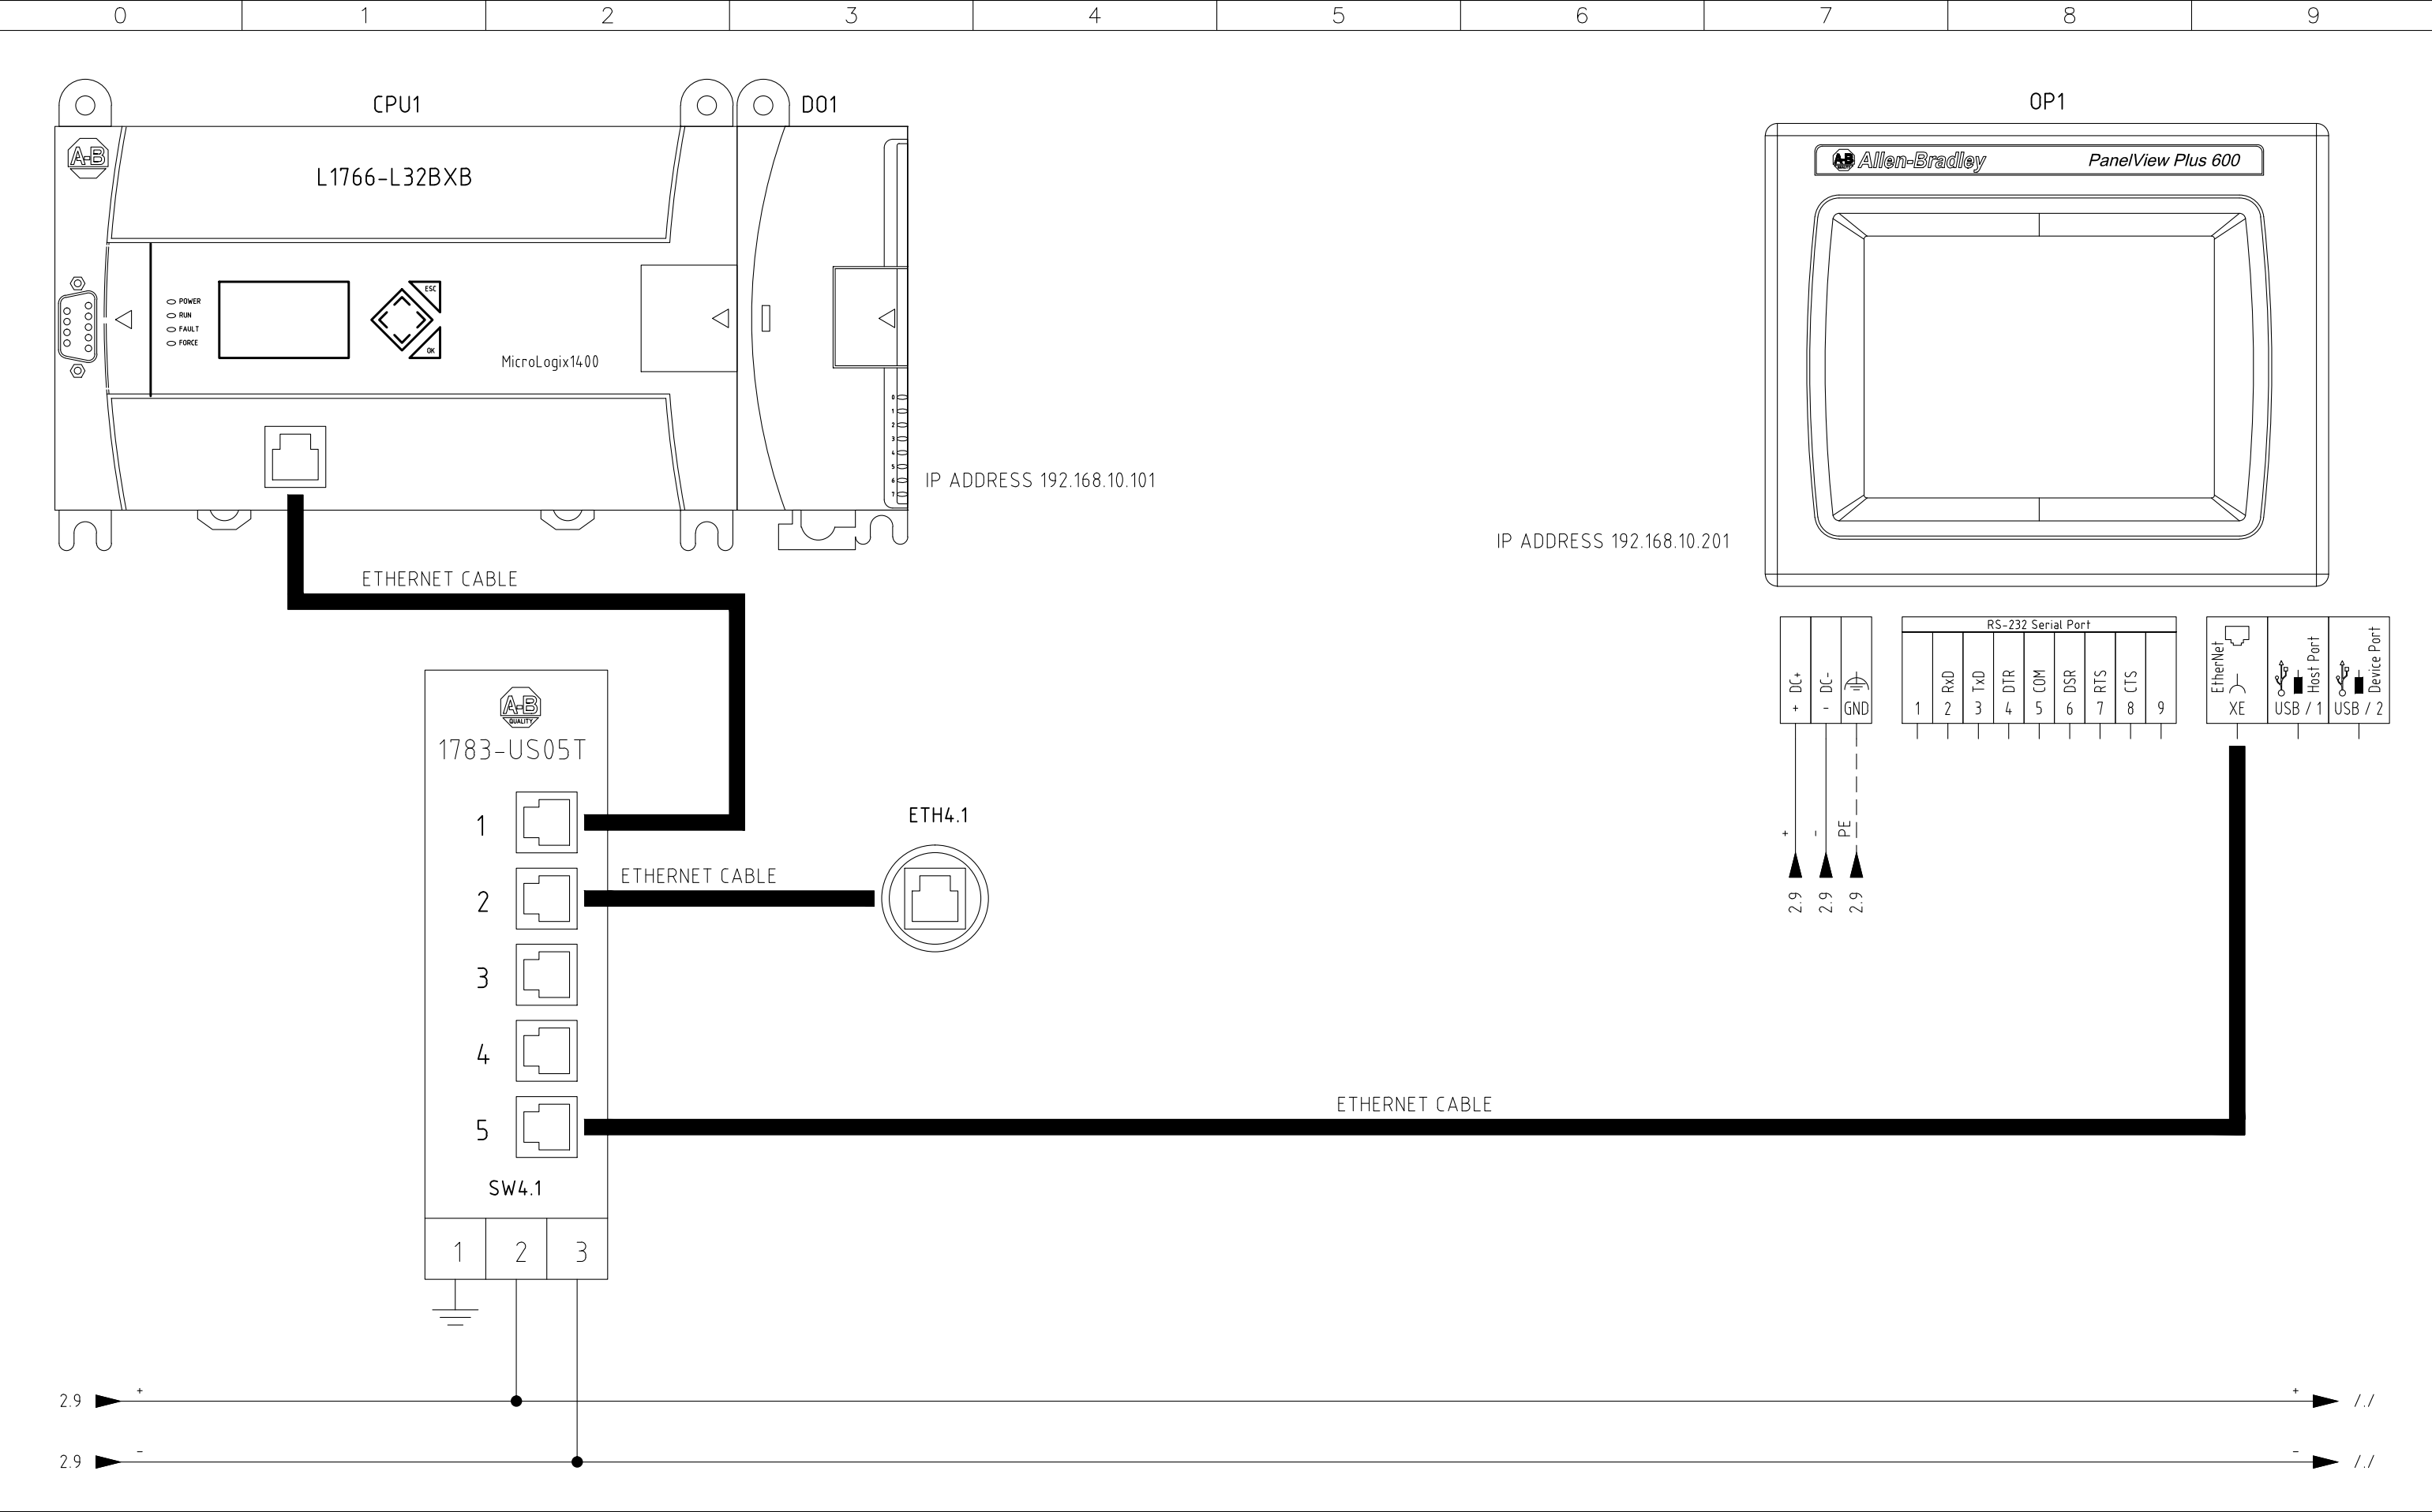

MAZZONI L B S.p.A. BUSTO ARSIZIO – ITALY	Code C.B. : 3028883		Customer : C.I.L. – CAMEROUN		Scale	Job No. : R.500676.01	Sheet 4	
	Code E.F. : —		Plant : SB–CR 72T/J – QE–106.02				Next 5	
	Cad : SPAC2014		Description : LAN CONFIGURATION			Quantity	Draw No. : SE13174	Total 14
	Date : 21–1–15		Drawn : P.D.		Checked :			
	This drawing is reserved property and cannot be copied or reproduced without our written authorisation.							

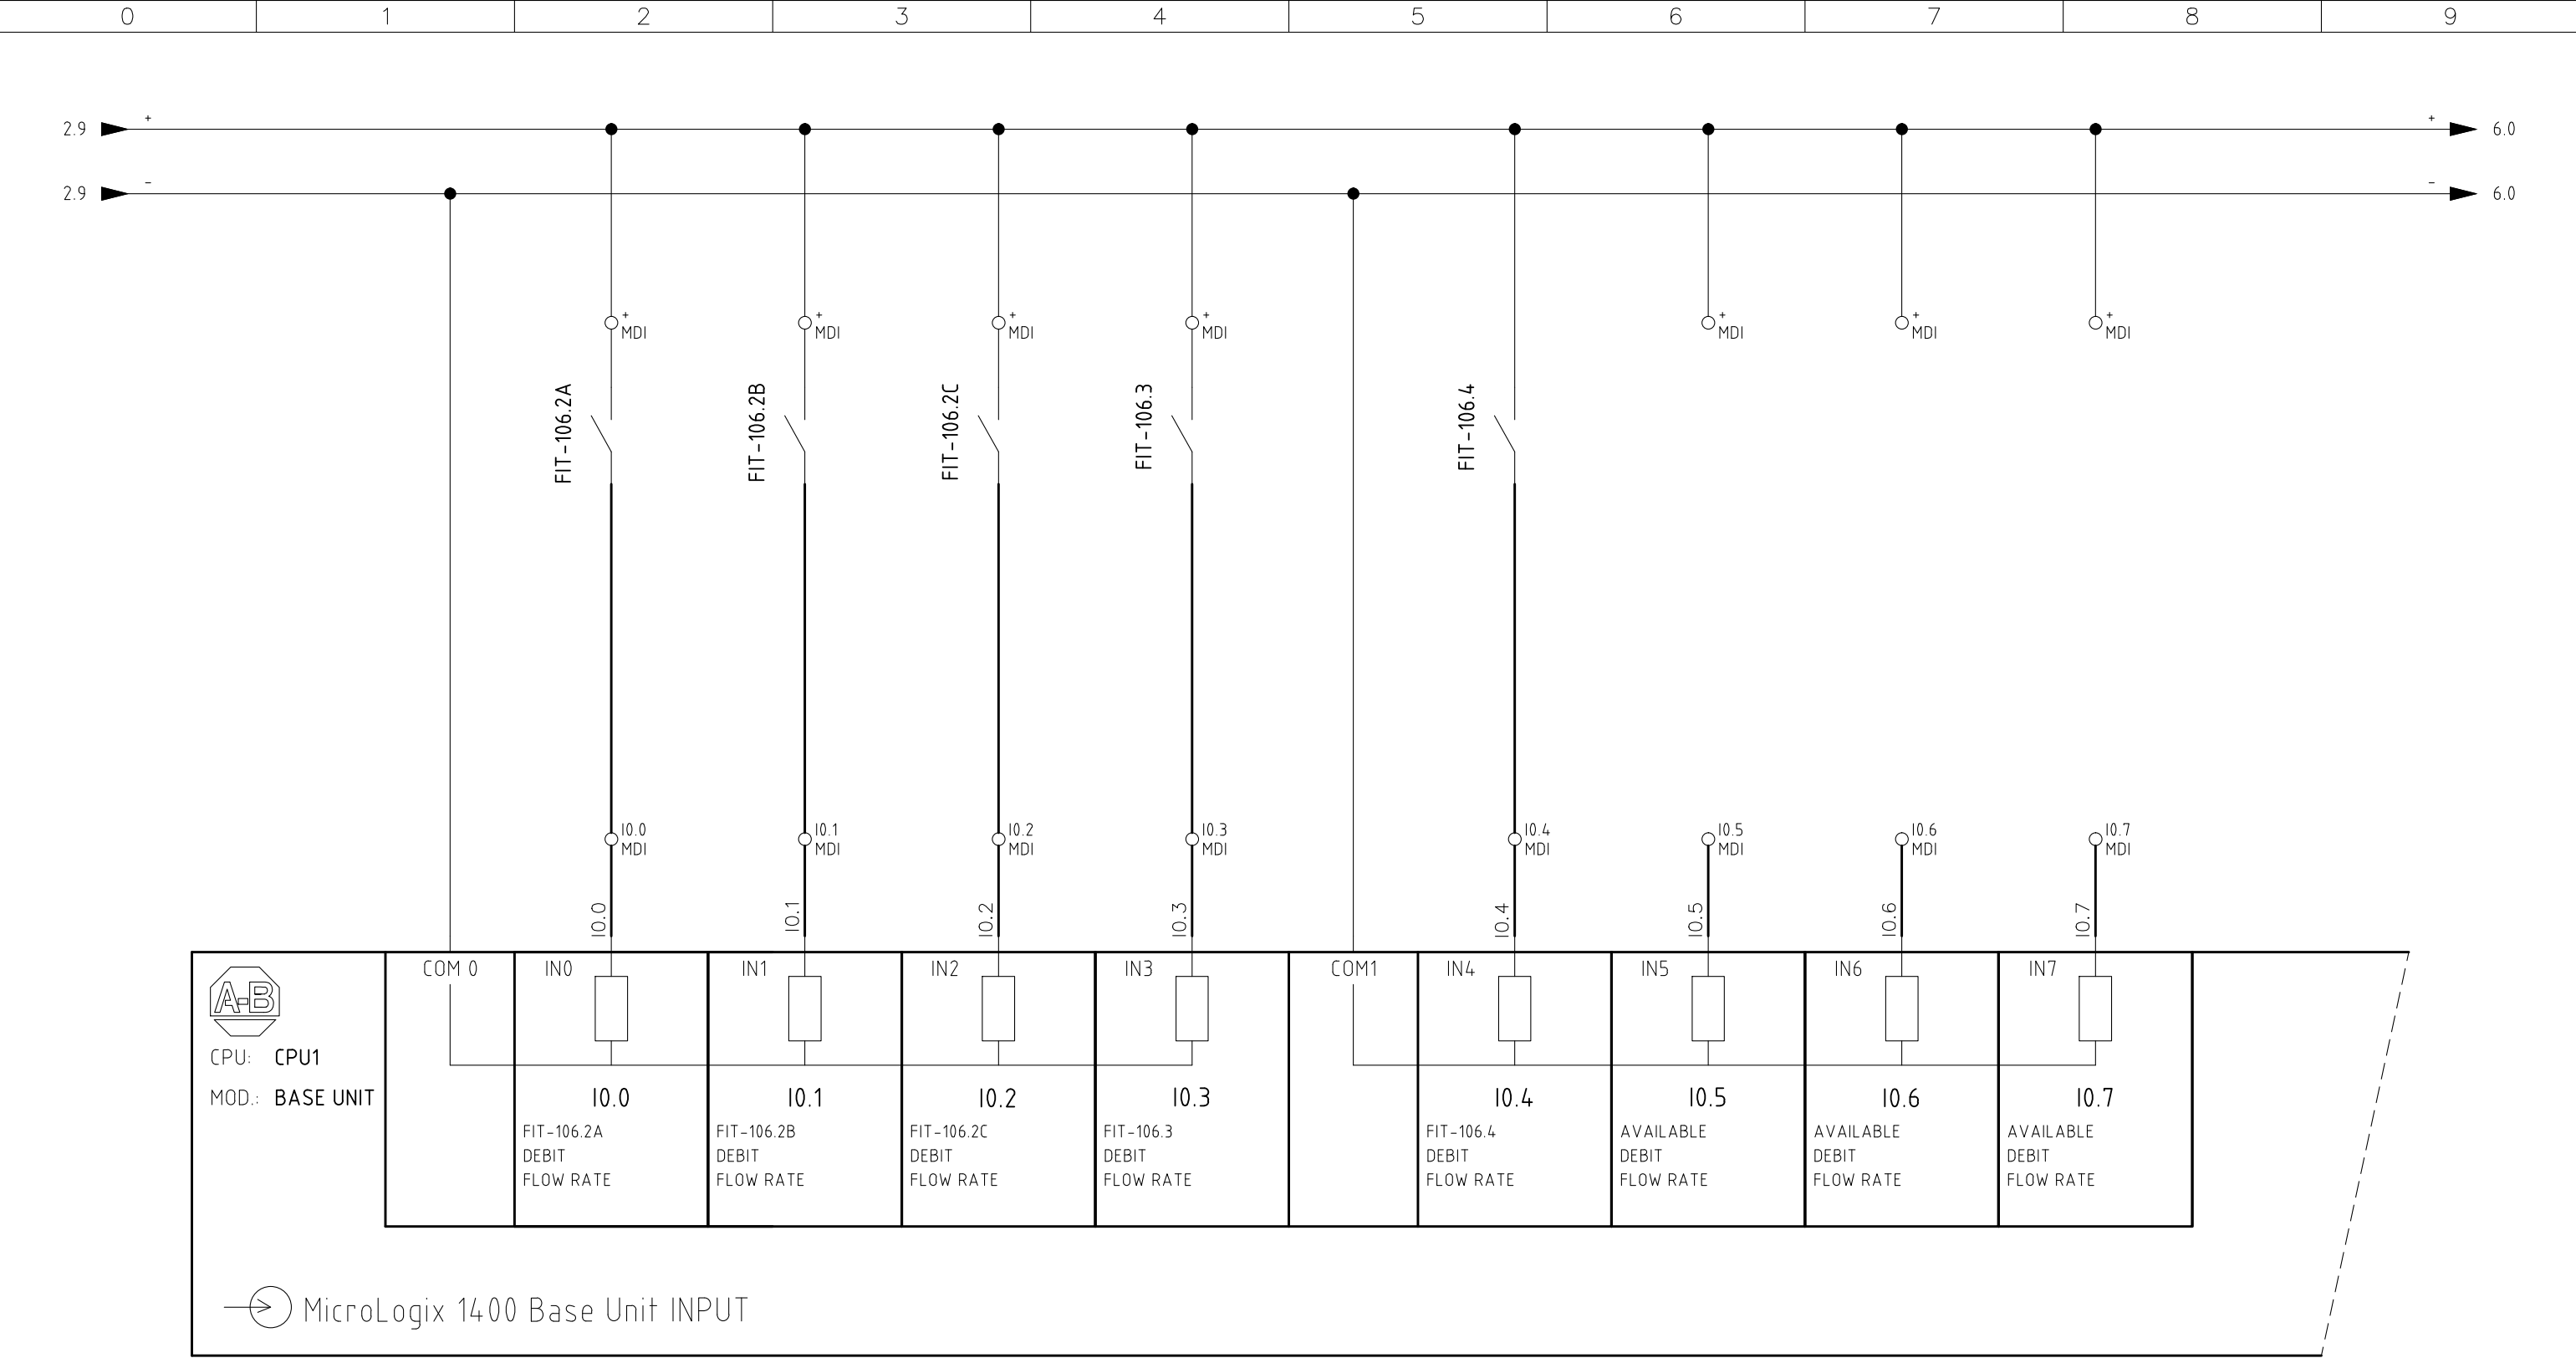









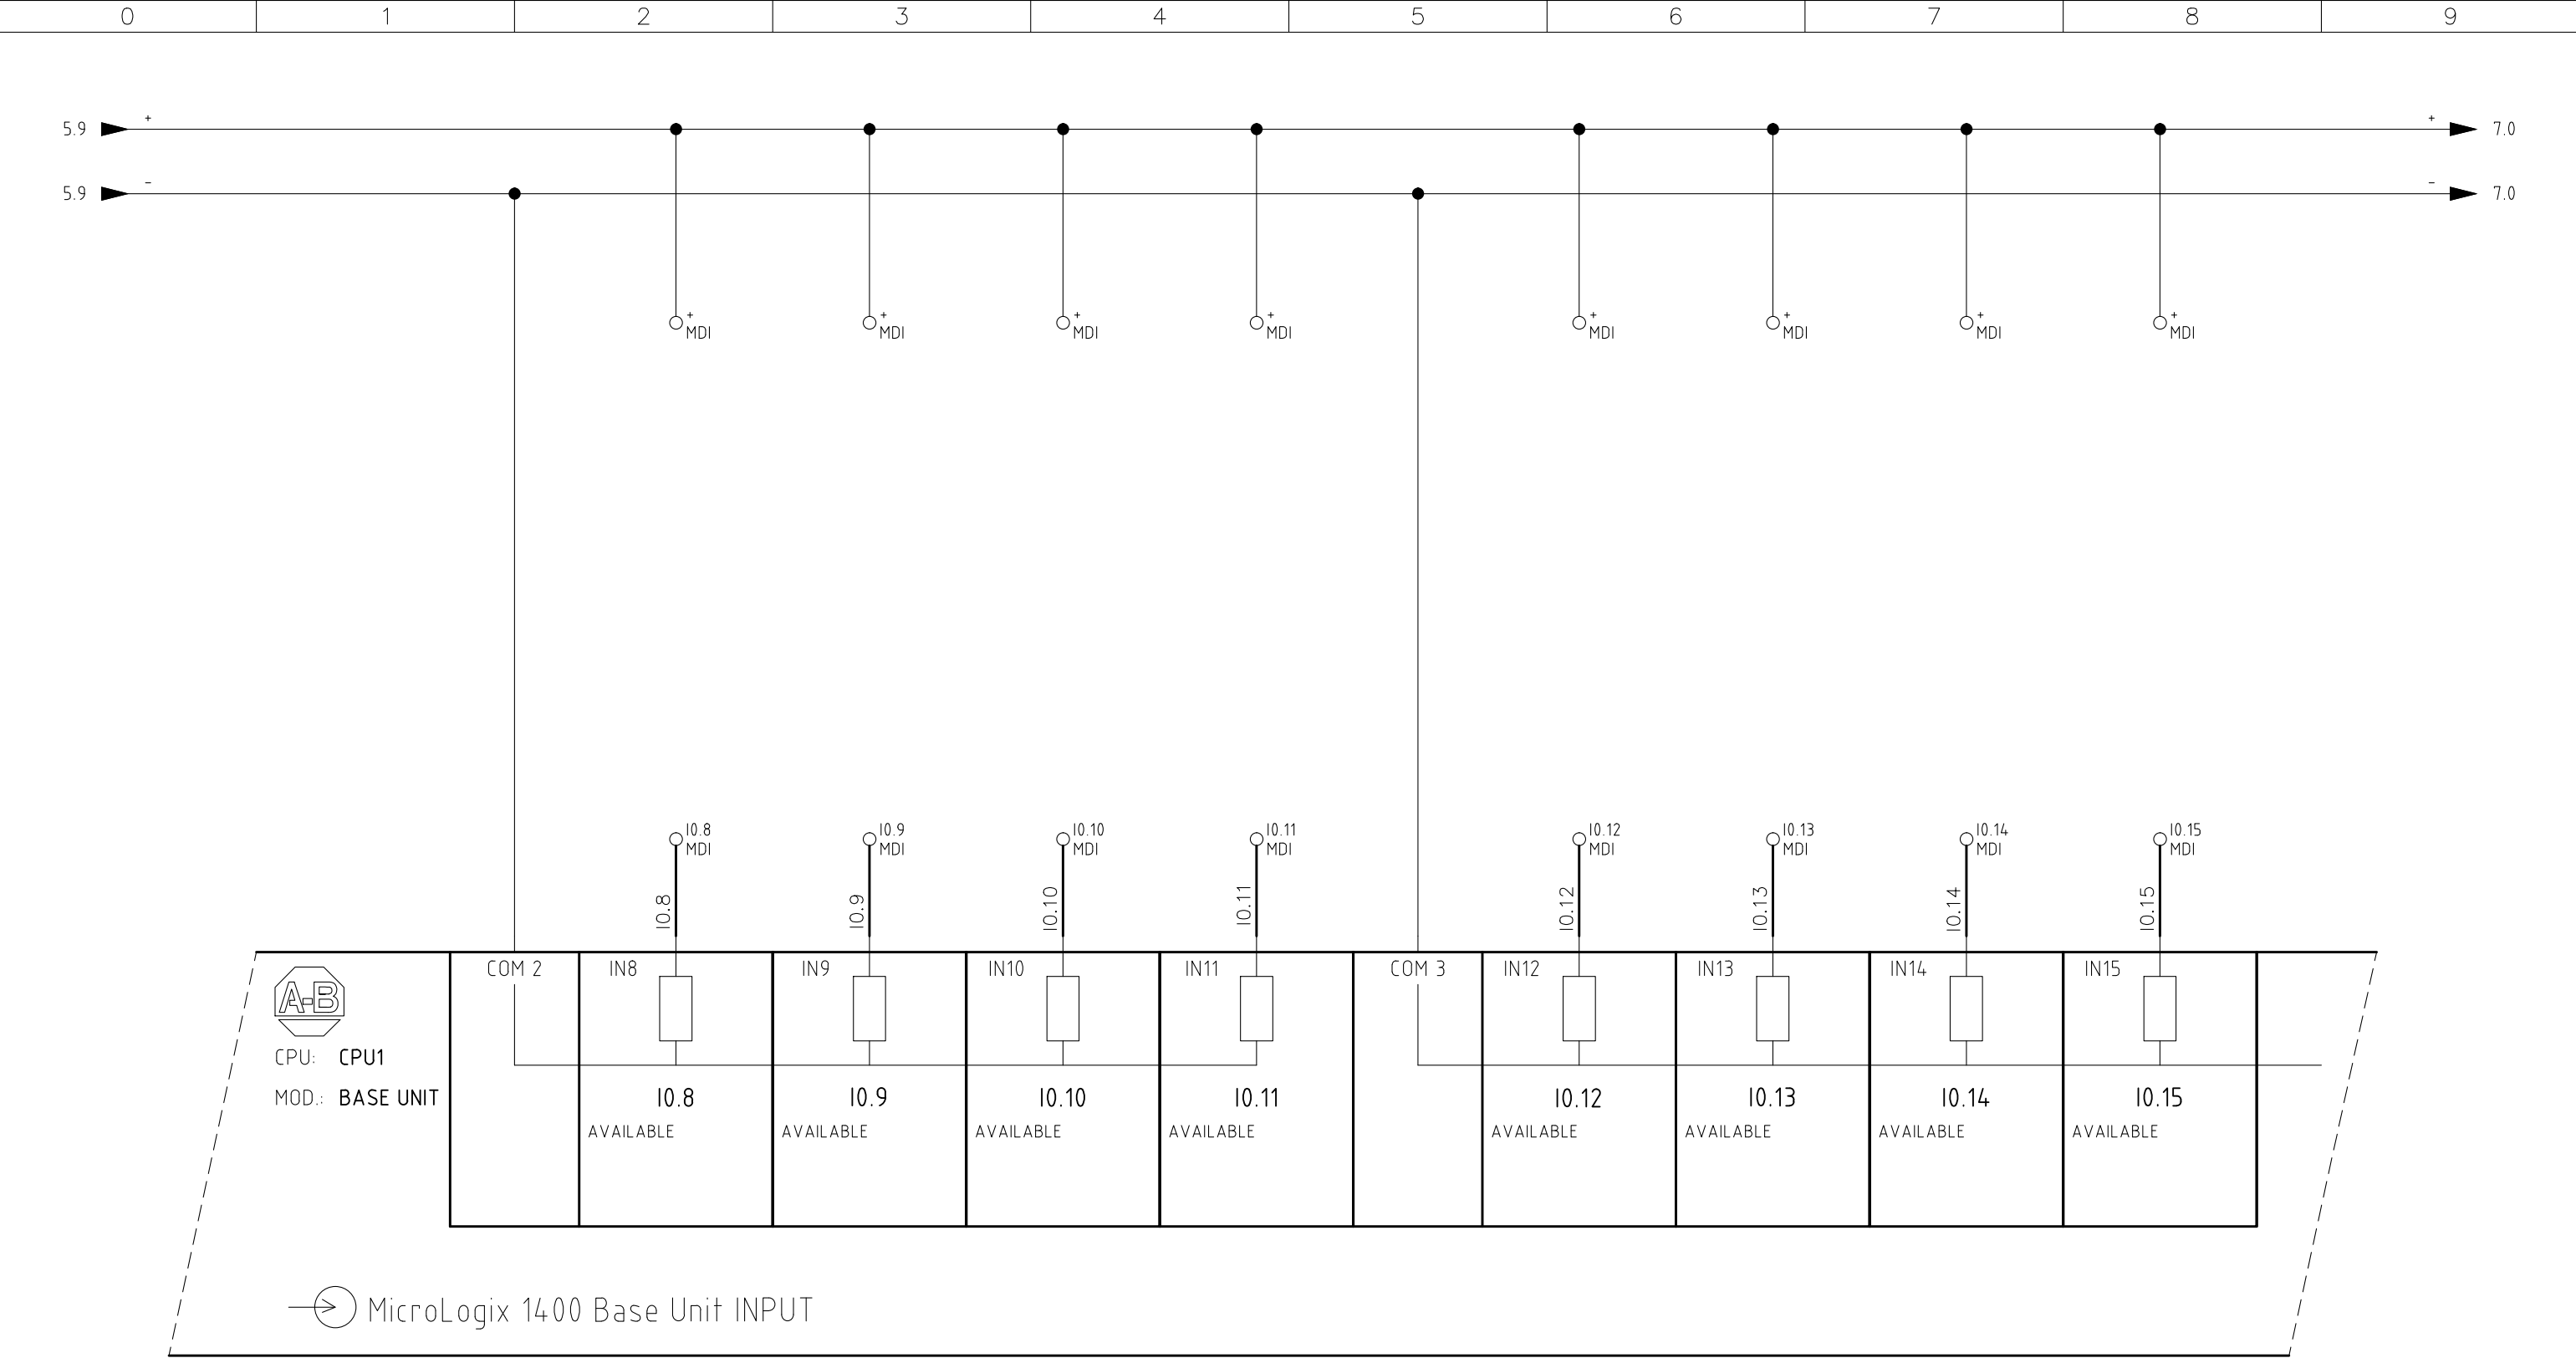


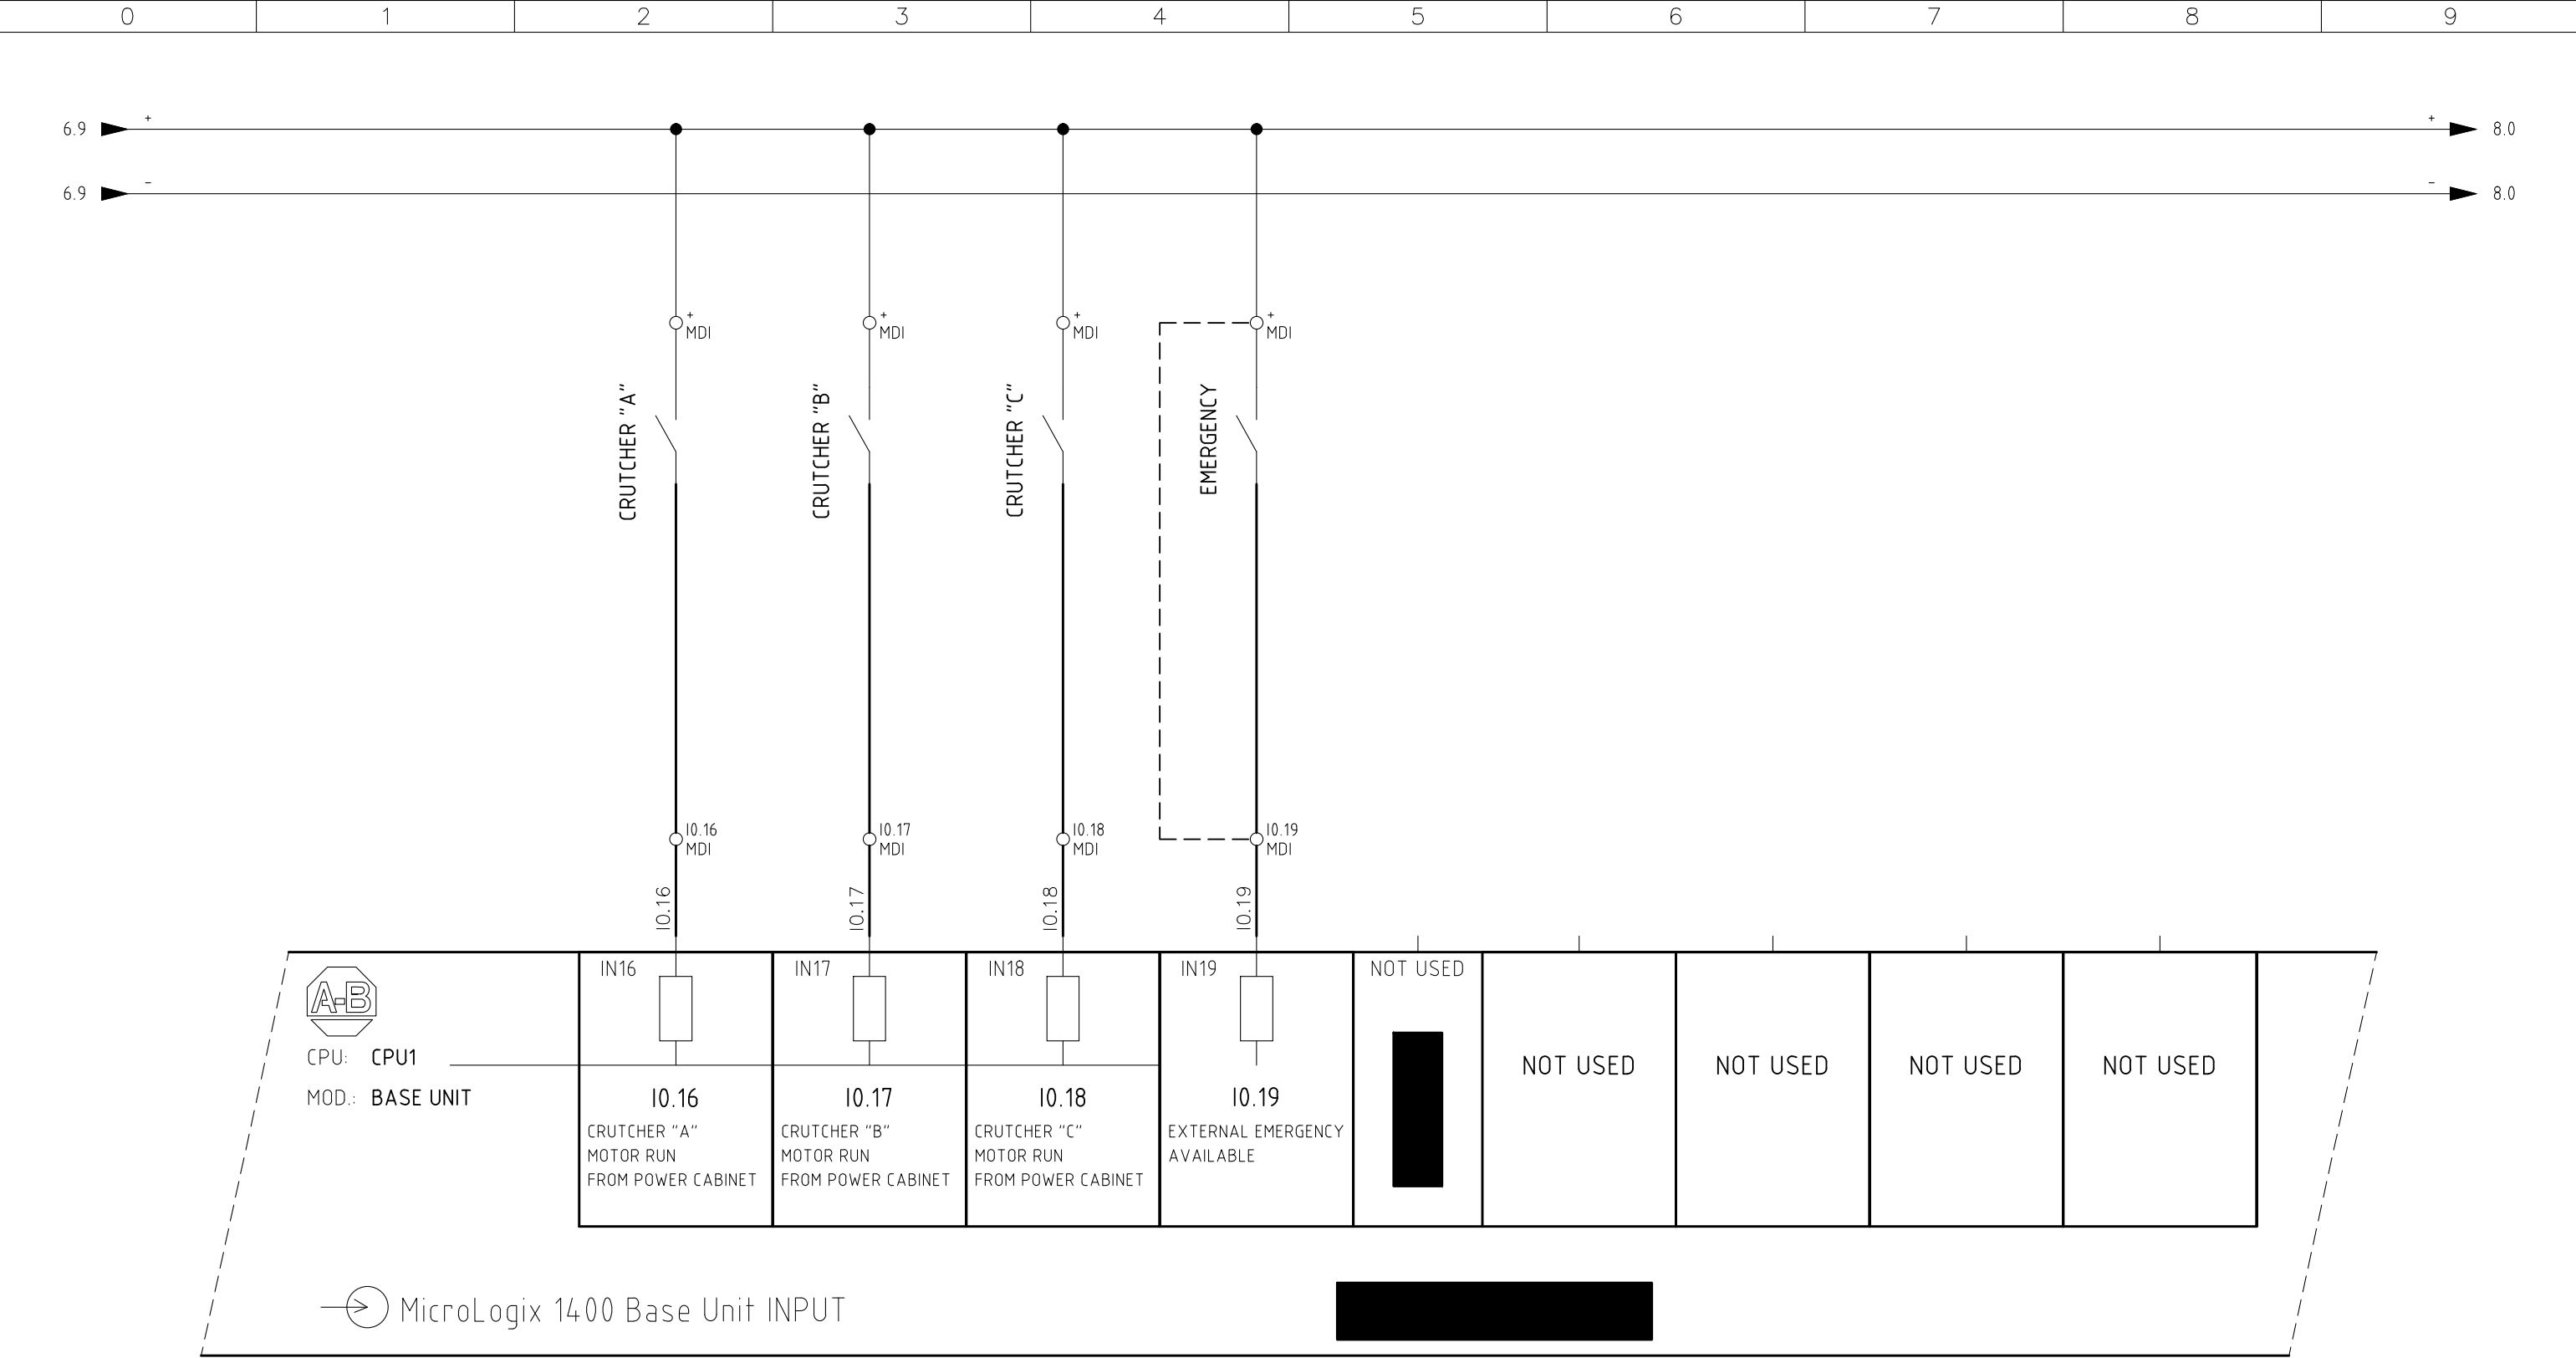



MicroLogix 1400 Base Unit OUTPUT

CPU: CPU1
MOD.: BASE UNIT

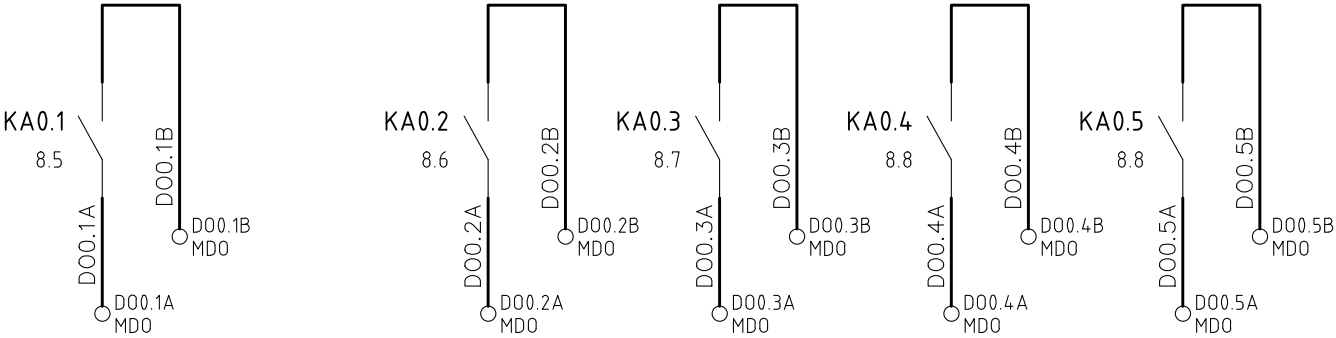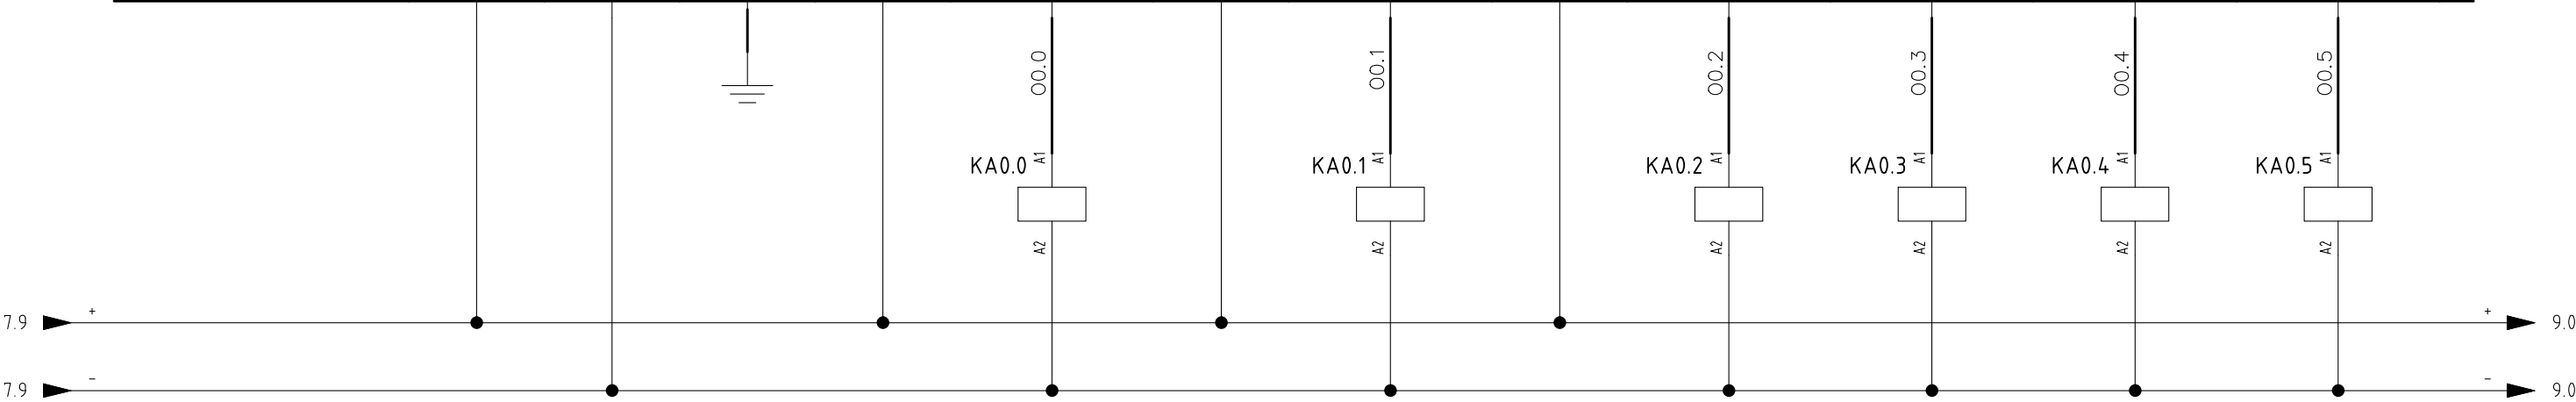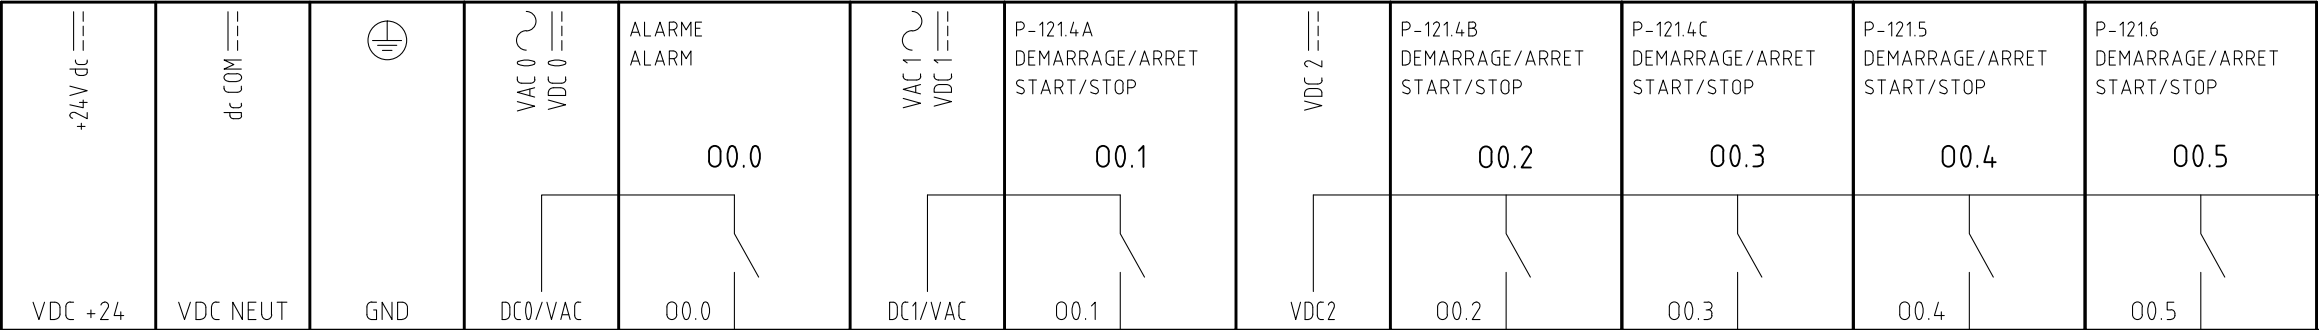

MAZZONI L B S.p.A. BUSTO ARSIZIO – ITALY




Code C.B. :3028883	Customer : C.I.L. – CAMEROUN	Scale	Job No. : R.500676.01	Sheet 8
Code E.F. : —	Plant : SB–CR 72T/J – QE–106.02			Next 9
Cad : SPAC2014	Description : PLC DIGITAL OUTPUT D00.0-D00.5	Quantity	Draw No. : SE13174	Total 14
Date : 21–1–15	Drawn : P.D.			

This drawing is reserved property and cannot be copied or reproduced without our written authorisation.



MicroLogix 1400 Base Unit OUTPUT



CPU: CPU1
MOD.: BASE UNIT

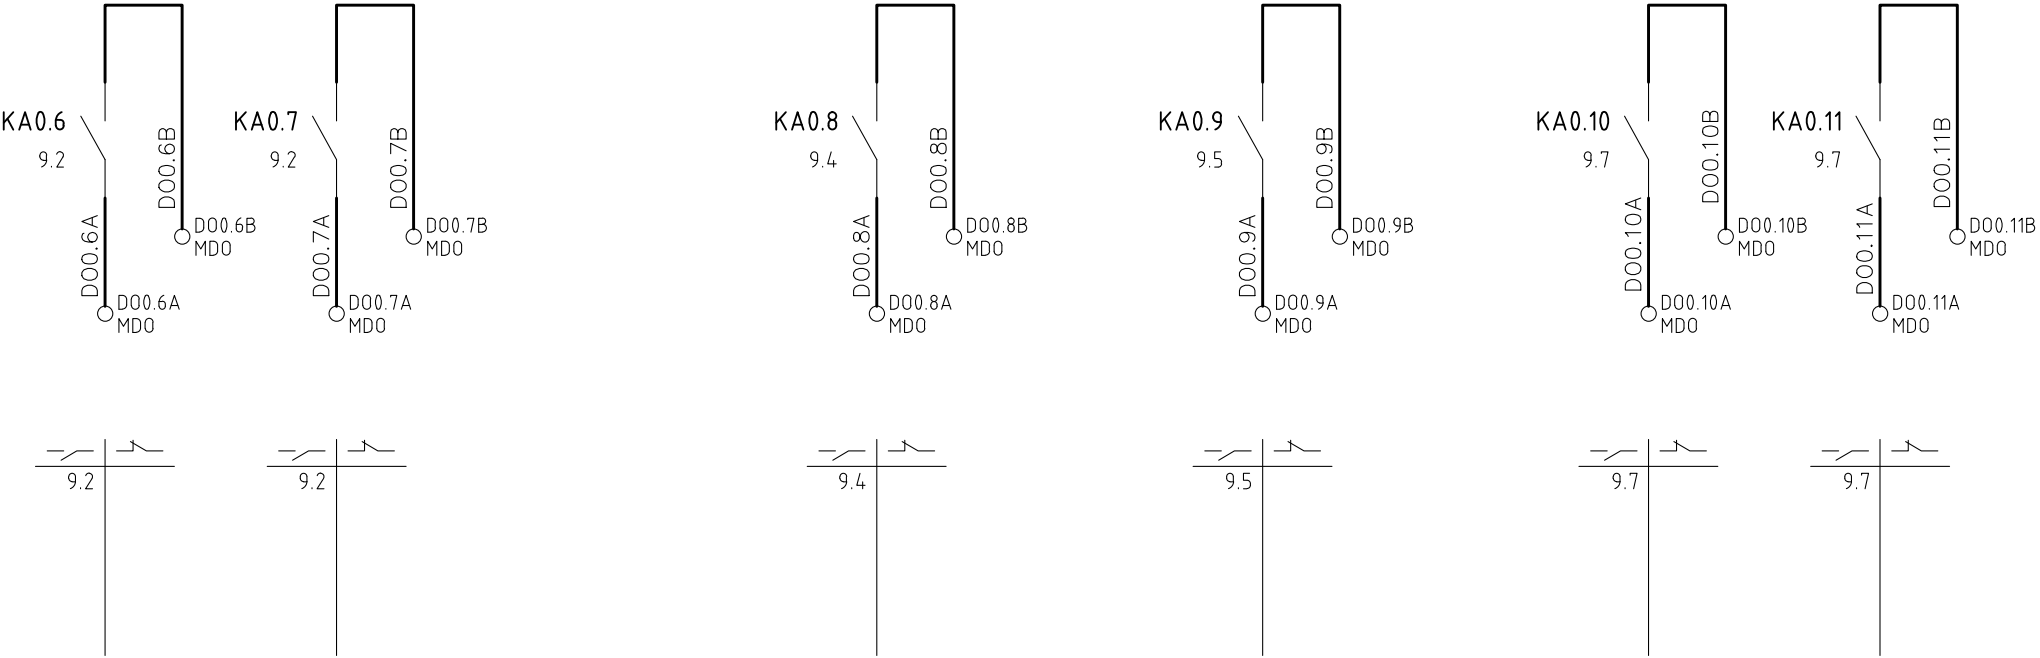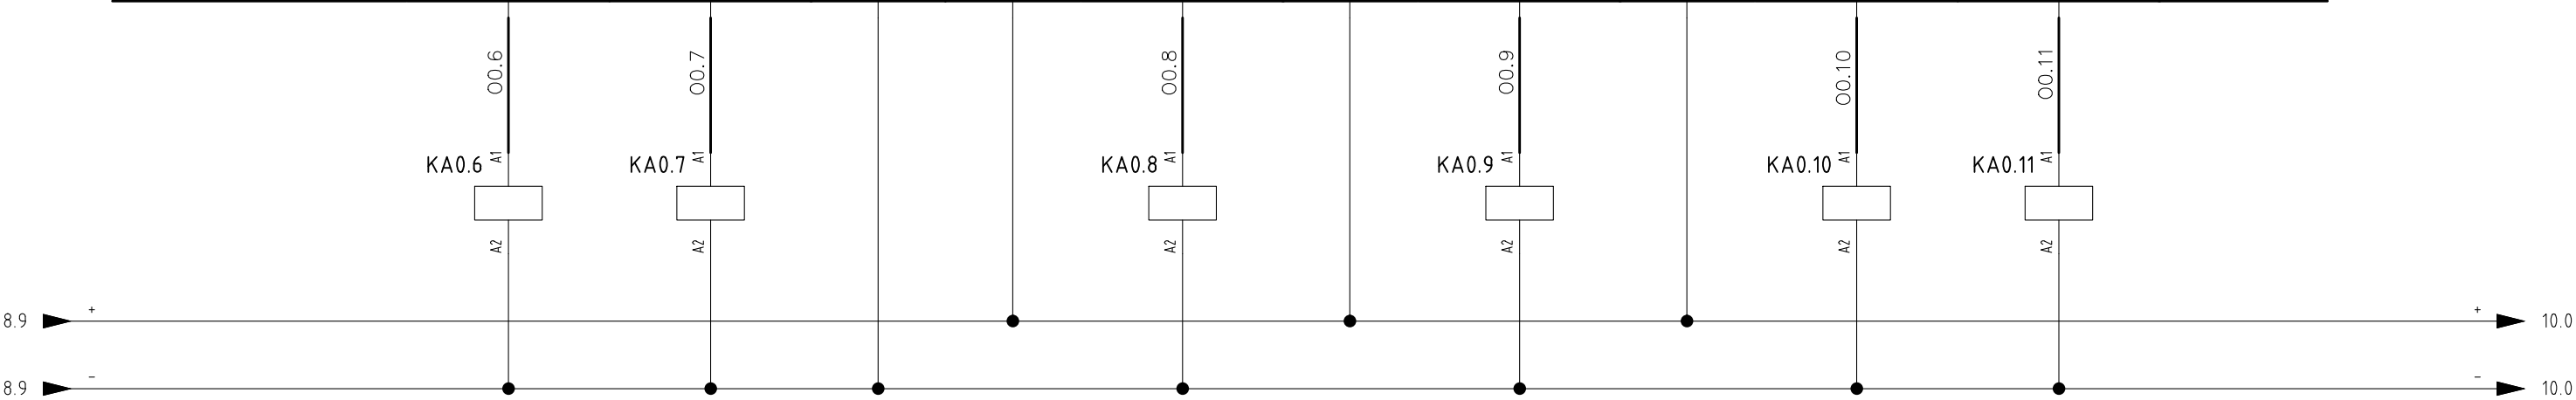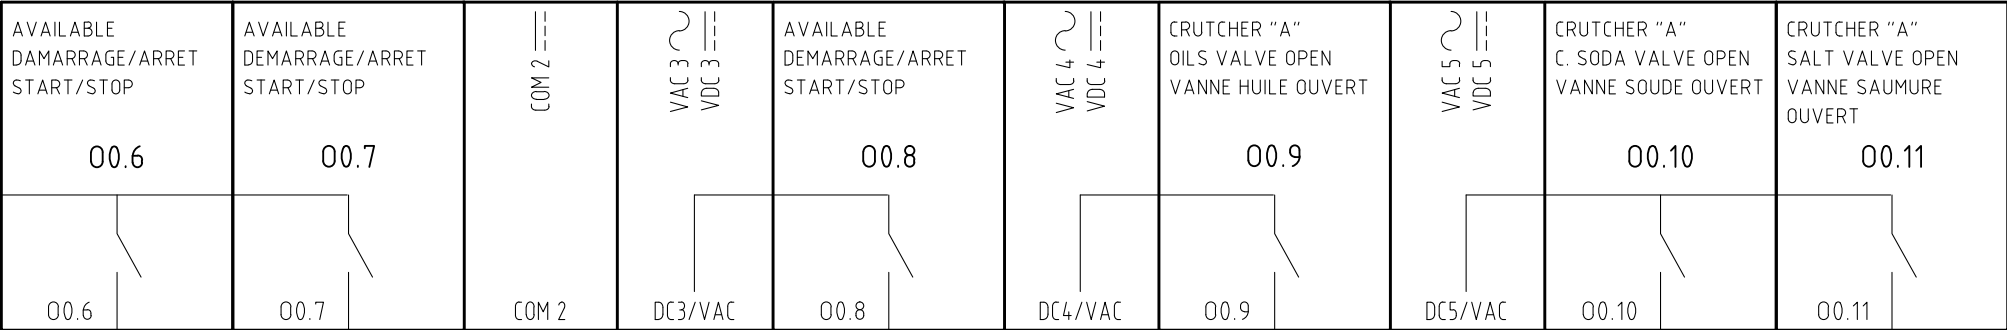

MAZZONI L B S.p.A. BUSTO ARSIZIO – ITALY

Code C.B. :3028883	Customer : C.I.L. – CAMEROUN	Scale	Job No. : R.500676.01	Sheet 9
Code E.F. : —	Plant : SB–CR 72T/J – QE–106.02			Next 10
Cad : SPAC2014	Description : PLC DIGITAL OUTPUT D00.6–D00.11	Quantity	Draw No. : SE13174	Total 14
Date : 21–1–15	Drawn : P.D.			

This drawing is reserved property and cannot be copied or reproduced without our written authorisation.

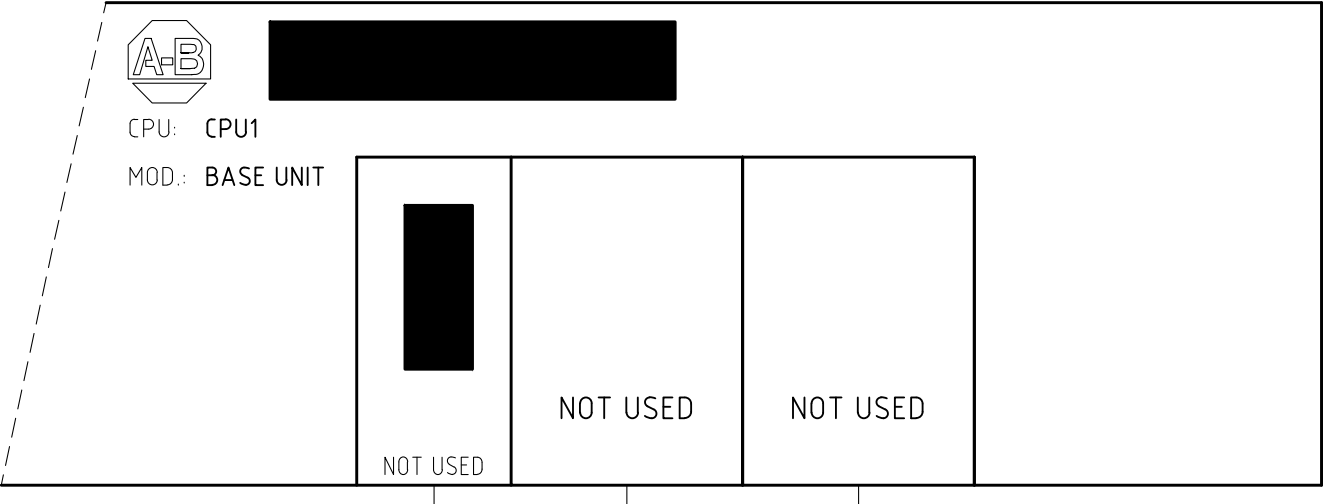

LIGNE ALIMENTATION
FEEDING LINE
380V - 50HZ

=QE106.2 – M1

	L1	⊙
	L2	⊙
	L3	⊙
	N	⊙
	PE	⊙

=QE106.2 – MD0

D00.1A	⊙
D00.1B	⊙
D00.2A	⊙
D00.2B	⊙
D00.3A	⊙
D00.3B	⊙
D00.4A	⊙
D00.4B	⊙
D00.5A	⊙
D00.5B	⊙
D00.6A	⊙
D00.6B	⊙
D00.7A	⊙
D00.7B	⊙
D00.8A	⊙
D00.8B	⊙
D00.9A	⊙
D00.9B	⊙
D00.10A	⊙
D00.10B	⊙
D00.11A	⊙
D00.11B	⊙
D01.0A	⊙
D01.0B	⊙
D01.1A	⊙
D01.1B	⊙
D01.2A	⊙
D01.2B	⊙
D01.3A	⊙
D01.3B	⊙
D01.4A	⊙
D01.4B	⊙
D01.5A	⊙
D01.5B	⊙
D01.6A	⊙
D01.6B	⊙
D01.7A	⊙
D01.7B	⊙

=QE106.2 – MDI

+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
+	●	⊙
10.0		⊙
10.1		⊙
10.2		⊙
10.3		⊙
10.4		⊙
10.5		⊙
10.6		⊙
10.7		⊙
10.8		⊙
10.9		⊙
10.10		⊙
10.11		⊙
10.12		⊙
10.13		⊙
10.14		⊙
10.15		⊙
10.16		⊙
10.17		⊙
10.18		⊙
10.19		⊙

MAZZONI L B S.p.A. BUSTO ARSIZIO – ITALY	Code C.B. : 3028883	Customer : C.I.L. – CAMEROUN		Scale	Job No. : R.500676.01	Sheet 12
	Code E.F. : —	Plant : SB–CR 72T/J – QE–106.02				Next 13
	Cad : SPAC2014	Description : TERMINALS		Quantity	Draw No. : SE13174	Total 14
	Date : 21–1–15	Drawn : P.D.	Checked :			
	This drawing is reserved property and cannot be copied or reproduced without our written authorisation.					

Technical drawing of two electrical cabinets, showing front and side views with dimensions and safety labels.

Left Cabinet (Front View):

- Width: 600
- Height: 1700
- Base height: 100
- Features:
 - Top: Ventilation grille.
 - Center: Square access panel.
 - Below panel: Small circular indicator.
 - Left side: Lock mechanism.
 - Bottom left: Label "CB1" in a dashed box.
 - Bottom right: Zigzag line indicating a connection point.
- Safety Label (Warning):

ATTENZIONE

PERICOLO DI UCCISIONE E LESIONI GRAVI
 CAUSATE DALLA TENSIONE ELETTRICA
 • CHIUSURA DELLA PORTA PRIMA DI QUALSIASI MANOVRA
 • VERIFICA DELLO STATO DI CARICA
 • VERIFICA DELLA TENSIONE ELETTRICA
 • VERIFICA DELLA TENSIONE ELETTRICA

Right Cabinet (Side View):

- Width: 500
- Height: 1700
- Base height: 100
- Features:
 - Top: Ventilation grille.
 - Right side: Lock mechanism.
 - Bottom right: Zigzag line indicating a connection point.

MAZZONI L B S.p.A. BUSTO ARSIZIO – ITALY	Code C.B. : 3028883	Customer : C.I.L. – CAMEROUN		Scale	Job No. : R.500676.01	Sheet 13
	Code E.F. : —	Plant : SB–CR 72T/J – QE–106.02				Next 14
	Cad : SPAC2014	Description : CONTROL BOARD LAYOUT		Quantity	Draw No. : SE13174	Total 14
	Date : 21–1–15	Drawn : P.D.	Checked :			
	This drawing is reserved property and cannot be copied or reproduced without our written authorisation.					

